

Duct/Immersion sensor Temperature

For measuring temperature in duct applications. In connection with a stainless steel or brass thermowell also applicable for pipe applications. NEMA 4X / IP65 rated enclosure.

### Technical data sheet

- CONTRO

## 01DT-5L.



#### **Type Overview**

Output signal	Probe length	Probe diameter
NTC10k (10k2)	2" [50 mm]	0.24" [6 mm]
NTC10k (10k2)	4" [100 mm]	0.24" [6 mm]
NTC10k (10k2)	6" [150 mm]	0.24" [6 mm]
NTC10k (10k2)	8" [200 mm]	0.24" [6 mm]
NTC10k (10k2)	12" [300 mm]	0.24" [6 mm]
NTC10k (10k2)	18" [450 mm]	0.24" [6 mm]
	NTC10k (10k2) NTC10k (10k2) NTC10k (10k2) NTC10k (10k2) NTC10k (10k2)	NTC10k (10k2)         2" [50 mm]           NTC10k (10k2)         4" [100 mm]           NTC10k (10k2)         6" [150 mm]           NTC10k (10k2)         8" [200 mm]           NTC10k (10k2)         12" [300 mm]

#### **Technical data**

Electrical Data	Electrical connection	Pluggable spring loaded terminal block max. 2.5 mm²
	Cable entry	Cable gland with strain relief Ø68 mm (1/2" NPT conduit adapter included)
Functional Data	Application	air water
	Output signal passive temperature	NTC10k (10k2)
Measuring Data	Measured values	Temperature
	Measuring range temperature	-60300°F [-50150°C]
	Accuracy temperature passive	±0.35°F @ 77°F [±0.2°C @ 25°C]
	Measuring current	<2 mA @ 77°F [25°C]
	Time constant τ (63%) in air duct	Typical 210 s @ 0 m/s Typical 46 s @ 3 m/s
	Time constant τ (63%) in water pipe	With thermowell A-22P-A and thermal contact fluid Typical 7 s with thermowell brass Typical 9 s with thermowell stainless steel
Materials	Cable gland	Plug Adapter: PA66, black Nut: PA6, black
	Housing	Cover: PC, orange Bottom: PC, orange Seal: NBR70, black UV resistant
	Probe material	AISI 316L
Safety Data	Protection class IEC/EN	III, Protective Extra-Low Voltage (PELV)
	Power source UL	Class 2 Supply
	Degree of protection IEC/EN	IP65
	Degree of protection NEMA/UL	NEMA 4X
	EU Conformity	CE Marking



01DT-5L..


Safety Data	Certification IEC/EN IEC/EN 607	30-1
	Quality Standard ISO 9001	
	UL Approval CULus acc. 1 E60730-1/-2	to UL60730-1A/-2-9, CAN/CSA 2-9
	Type of action Type 1	
	Rated impulse voltage supply 0.8 kV	
	Installation method Independent	ntly mounted control
	Pollution degree 3	
	Ambient humidity Max. 95% R	RH, non-condensing
	Ambient temperature -3550°C [-	-30122°F]
	· · ·	[-50150°C]
	Housing surface temperature max. 195°F	[90°C]
Safety Notes		
<u> </u>	<ul> <li>systems and must not be used outside the specified field of application. Unauthorized</li> <li>modifications are prohibited. The product must not be used in relation with any equipment the in case of a failure may threaten humans, animals or assets.</li> <li>Ensure all power is disconnected before installing. Do not connect to live/operating equipment Only authorized specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.</li> <li>The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.</li> </ul>	
Remarks General Remarks Concerning Sensors	Due to self-heating with 2 wire passive sensors, the supply v	
	measurement accuracy. So the supply current should not be	e higher than the measuring curren
	values specified in this data sheet.	j
	When using lengthy connecting cables (depending on the consistance must be taken into account. The lower the imped the effect of the line resistance on the measurement, becau	ross section used), the cable lance of the sensor used, the greate
Parts included	When using lengthy connecting cables (depending on the corresistance must be taken into account. The lower the imped	ross section used), the cable lance of the sensor used, the greate
Parts included Scope of delivery	When using lengthy connecting cables (depending on the corresistance must be taken into account. The lower the imped	ross section used), the cable lance of the sensor used, the greate
	When using lengthy connecting cables (depending on the corresistance must be taken into account. The lower the imped the effect of the line resistance on the measurement, becau	ross section used), the cable lance of the sensor used, the greate se it generates an offset.
	When using lengthy connecting cables (depending on the corresistance must be taken into account. The lower the imped the effect of the line resistance on the measurement, becau	ross section used), the cable lance of the sensor used, the greate se it generates an offset. <b>Type</b>
Scope of delivery	When using lengthy connecting cables (depending on the corresistance must be taken into account. The lower the imped the effect of the line resistance on the measurement, becau	ross section used), the cable lance of the sensor used, the greate se it generates an offset. <b>Type</b>
Scope of delivery Accessories	When using lengthy connecting cables (depending on the corresistance must be taken into account. The lower the imped the effect of the line resistance on the measurement, becau         Description         Mounting clip, with screws and adhesive foil         1/2" NPT conduit adapter	ross section used), the cable lance of the sensor used, the greate se it generates an offset. Type A-22D-A11 Type A-22D-A09
Scope of delivery Accessories	When using lengthy connecting cables (depending on the corresistance must be taken into account. The lower the imped the effect of the line resistance on the measurement, becau         Description         Mounting clip, with screws and adhesive foil         1/2" NPT conduit adapter         Description         Mounting plate S housing         Connection adapter flex conduit, M20x1.5, for cable gland 1	ross section used), the cable lance of the sensor used, the greate se it generates an offset. Type           A-22D-A11           Type           A-22D-A09




## 01DT-5L.


Recommended accessories water	Description	Туре
	Thermowell (fabricated) Stainless steel, 2" [50 mm], 1/2" NPT, SW = 3/4"	A-22P-A05
	Thermowell (fabricated) Brass, 2" [50 mm], 1/2" NPT, SW = 3/4"	A-22P-A17
	Thermowell (machined) Stainless steel, 2" [50 mm], 1/2" NPT, SW = 3/4"	A-22P-A36
	Syringe with thermal paste	A-22P-A44
	Thermowell (fabricated) Stainless steel, 4" [100 mm], 1/2" NPT, SW = 3/4"	A-22P-A07
	Thermowell (fabricated) Brass, 4" [100 mm], 1/2" NPT, SW = 3/4"	A-22P-A19
	Thermowell (machined) Stainless steel, 4" [100 mm], 1/2" NPT, SW = 3/4"	A-22P-A37
	Cold barrier, Plastic, L 50 mm, for thermowell A-22P-A	A-22P-A51
	Thermowell (fabricated) Stainless steel, 6" [150 mm], 1/2" NPT, SW = 3/4"	A-22P-A09
	Thermowell (fabricated) Brass, 6" [150 mm], 1/2" NPT, SW = 3/4"	A-22P-A21
	Thermowell (machined) Stainless steel, 6" [150 mm], 1/2" NPT, SW = 3/4"	A-22P-A38
	Thermowell (fabricated) Stainless steel, 8" [200 mm], 1/2" NPT, SW = 3/4"	A-22P-A11
	Thermowell (fabricated) Brass, 8" [200 mm], 1/2" NPT, SW = 3/4"	A-22P-A23
	Thermowell (machined) Stainless steel, 8" [200 mm], 1/2" NPT, SW = 3/4"	A-22P-A39
	Thermowell (fabricated) Stainless steel, 12" [300 mm], 1/2" NPT, SW = 3/4"	A-22P-A13
	Thermowell (fabricated) Brass, 12" [300 mm], 1/2" NPT, SW = 3/4"	A-22P-A25
	Thermowell (fabricated) Stainless steel, 18" [450 mm], 1/2" NPT, SW = 3/4"	A-22P-A15
	Thermowell (fabricated) Brass, 18" [450 mm], 1/2" NPT, SW = 3/4"	A-22P-A27

# Wiring Diagram

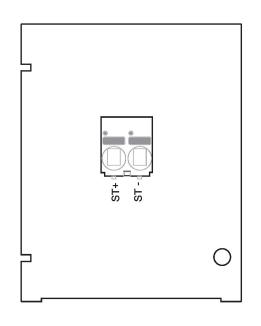





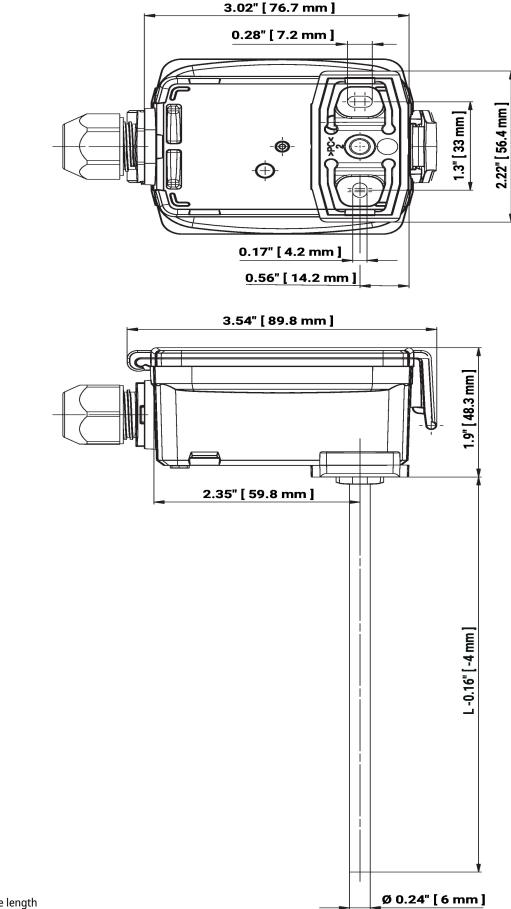

L = Probe length



01DT-5L..

Probe length	Weight
2" [50 mm]	0.26 lb [0.12 kg]
4" [100 mm]	0.26 lb [0.12 kg]
6" [150 mm]	0.29 lb [0.13 kg]
8" [200 mm]	0.29 lb [0.13 kg]
12" [300 mm]	0.31 lb [0.14 kg]
18" [450 mm]	0.33 lb [0.15 kg]
	2" [50 mm] 4" [100 mm] 6" [150 mm] 8" [200 mm] 12" [300 mm]

#### **Further documentation**

- Installation instructions
- Resistance characteristics
- Sensor length calculator